District of SECHELT

Septage Receiving Facility Report Card

The septage receiving facility functions as a service to provide disposal and preprocessing of sludge found in the regular maintenance in private septic tank. This facility serves the entire sunshine coast including government and industrial users.

Replacement Cost

2.9 Million

Average Condition

Poor

Inventory

Septage Receiver, Aeration Grid & Blowers, Service water system, Underground piping, Clarifier, Storage tanks, Septage building, Non potable water system

Cost to Replace Assets in Very Poor Condition

$450,000

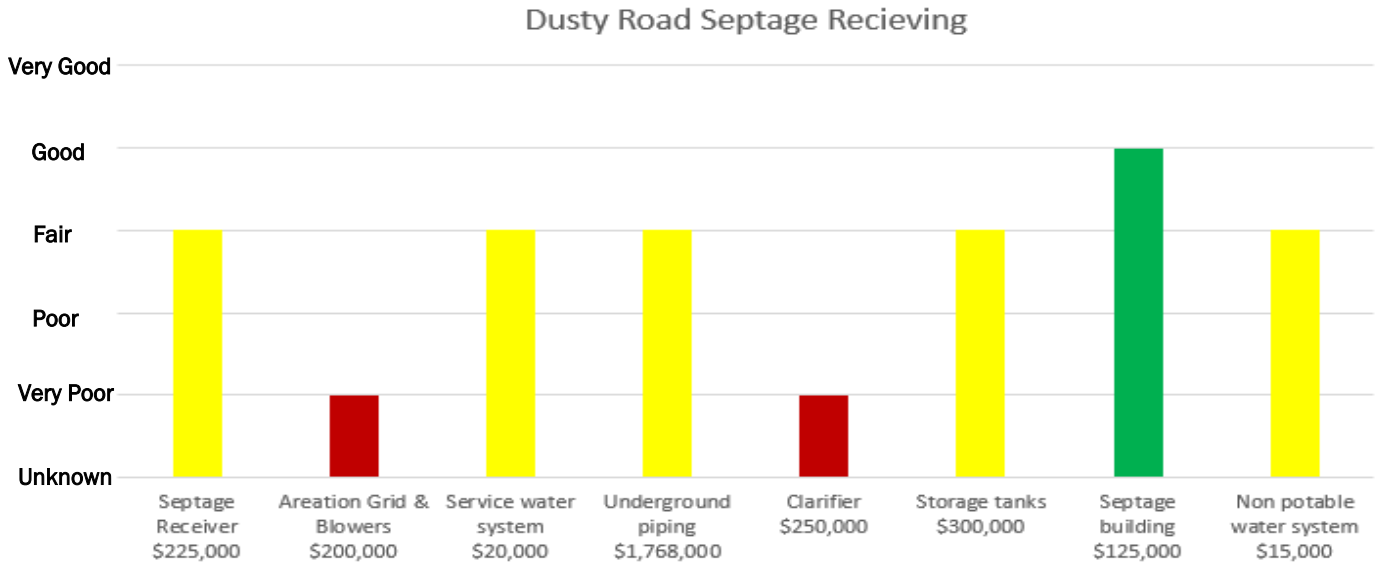

** Replace cost estimates are based on current assets. Future plans will result in a reduced facility after decommissioning.

Staff Assigned to Manage Assets: Manager of Wastewater

Data Confidence Rating

A- Verified Condition and Analytical Techniques
B- Observed Condition
C- Age Only
D- Historical Knowledge
F- Assumptions