District of SECHELT

Wastewater Treatment System Report Card

The District's Wastewater Treatment System is a main component of the wastewater system. Treatment occurs at the Water Resource Centre where various pumps, processes and filters treat the wastewater that is collected from gravity and pressurized mains.

Replacement Cost
43 Million

Average Condition
GOOD

Inventory
26 Facility Systems

Est Cost to Replace Assets listed in Very Poor Condition
$300,000.00

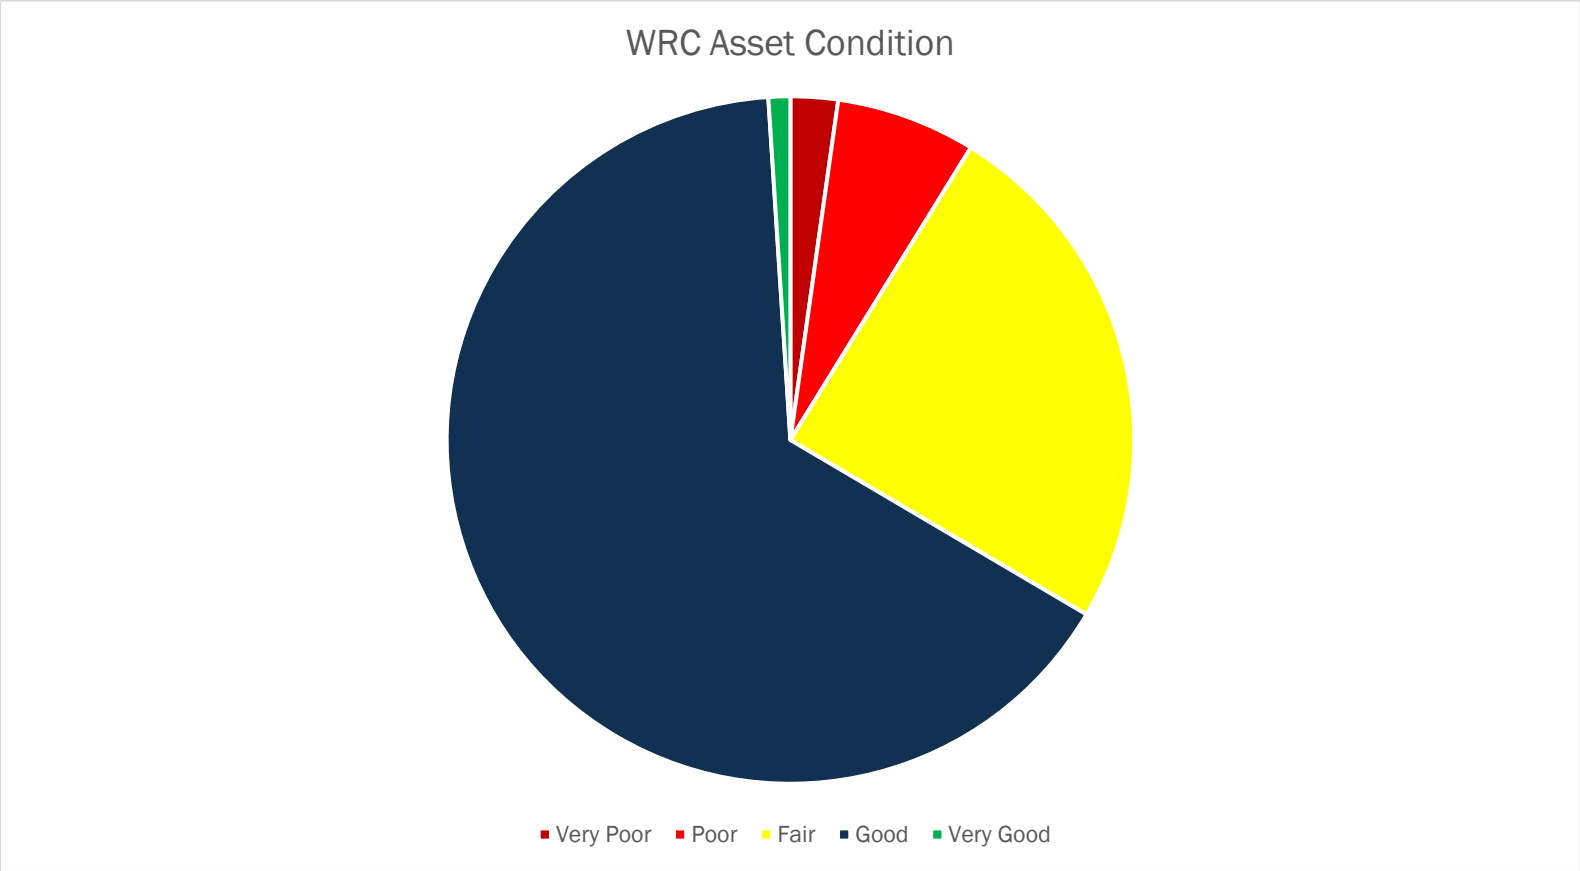

Staff Assigned to Manage Assets: Manager of Wastewater

Data Confidence Rating

A- Verified Condition and Analytical Techniques
B- Observed Condition
C- Age Only
D- Historical Knowledge
F- Assumptions